

- NOTES:**
- DIV 26, DIV 27, AND ELECTRICAL METERING SCHEMATIC FOR ELECTRICAL REQUIREMENTS
 - INSTALL PER METER MANUFACTURER'S INSTRUCTIONS AND PER CUO STANDARDS
 - SEE MECHANICAL METER REQUIREMENTS SPREADSHEET FOR METER MODELS AND ASSOCIATED REQUIREMENTS
 - DATA COLLECTION CONTROLLER FURNISHED BY UW CAMPUS UTILITIES AND OPERATIONS AND REIMBURSED BY PROJECT
 - PROGRAMMING BY SYSTEMS INTEGRATOR

- LOW VOLTAGE CABLES AND WIRES:**
- INSTALL PER APPROPRIATE DIVISION.
 - ETHERNET CONNECTION - CAT6
 - 24VDC CONNECTION TO DATA COLLECTION CONTROLLER - BELDEN 88760 TWISTED-PAIR SHIELDED CABLE
 - 4-20MA FOR DIGITAL PULSE SIGNAL TO DATA COLLECTION CONTROLLER - BELDEN 88760 TWISTED-PAIR SHIELDED CABLE.

REVISIONS		
NO.	BY	DATE

E CASNE Engineering
 3545 FACTORIA BOULEVARD SE., SUITE 200
 BELLEVUE, WA 98006
 (425) 522-1000 WWW.CASNE.COM JOB NO. 201-061

PROJECT NAME:
**UNIVERSITY OF WASHINGTON
 METER SPECIFICATION UPDATE**

DRAWING TITLE:
**CAMPUS UTILITIES AND OPERATIONS
 23 00 00 ATTACHEMENT #1
 MECHANIC METER SCHEMATIC**


PROJECT NO. 178979	SCALE N/A	DATE 09/30/20	REVISION NO.
DESIGNED BY: RJJ	CHECKED BY:	DRAWING NO.	
DRAWN BY: RJJ	REVIEWED BY: MJH		



CAD ID:
 BLDG ID:
 PROJECT NO:
 FILE ID:

DETAIL

PUBLIC UTILITY SUPPLIED METERS
 INSTALL PER PUBLIC UTILITY REQUIREMENTS.
 ALL CONNECTIONS AND DATA ACQUISITIONS PER UW REQUIREMENTS

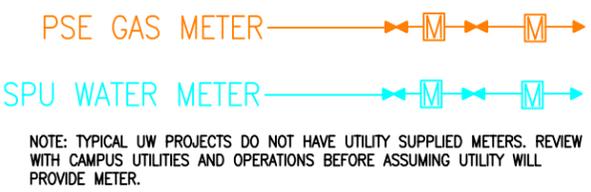

CONFIRM WITH CAMPUS UTILITIES AND OPERATIONS