

UW Facilities FIRE SAFETY AND EVACUATION PLAN and other emergency responses

Plant Services Building

4515 25th Avenue NE

Steve Snyder, Evacuation Director

March 2025

Customer Care Team (Shop 81)
Maintenance & Construction Administration
Construction (Shops 52, 53, 54, 56)
Moving & Surplus
Stores
Northeast Zone (Shops 15, 41)
Outside Zone (Shops 10, 18)
Regulated Materials (Shop 32)
Kanway LLC (Shop 32 Vendor Partner)
Facilities Safety
Facilities IT
Facilities Training Center / Partner Resources
UW Shuttles / Parking Maintenance



TABLE OF CONTENTS

TABLE OF CONTENTS	2
Building FSEP Revisions	4
UW Facilities template revisions	4
Section 1: General Information	5
Purpose	5
Section 2: Responsibilities and Duties	6
Responsibilities of Staff, Faculty and Other Personnel	6
Responsibilities of Classroom Trainers and Instructors	6
Responsibilities of Evacuation Director and Evacuation Wardens	7
Section 3: Evacuation Procedures	12
Evacuation Route Maps	12
Section 4: Emergency Procedures	14
Fire/Explosion	15
Earthquakes	16
Hazardous Material Spill or Release	17
Spill Response poster	19
Exposure Response Poster	20
Bomb Threats and Suspicious Mail	21
Medical Emergencies	22
Demonstrations / Protests	24
Critical Equipment Shutdowns	24
Active Shooter	25
Workplace Violence	26
Power Outages	26
Elevator Failure	28
Plumbing Problems and Flooding	29
Other Emergency Procedures	30
Section 5: Emergency Evacuation for Persons with Disabilities	31
Planning	31
Evacuation Options	31

Plant Services Building

Emergency Procedures.....	32
Other Disabilities	32
Section 6: Building-Specific Information.....	34
Section 7: Evacuation Methods & Assembly Locations.....	35
Building Evacuation.....	35
Outdoor Evacuation Assembly Point (EAP).....	35
Section 8 - Evacuation Director and Wardens.....	37
Appendix A: MyChem Contacts Reports.....	40
Appendix B: Critical Equipment Shutdown	41
Appendix C: List of First Aid Kit/AED/Severe Bleed Kit Locations	53
Appendix D: Additional Considerations.....	54
Appendix E: Bomb Threat Checklist	55
Appendix F: Post-Earthquake Checklist	57

Plant Services Building

REVISIONS TO THIS SPECIFIC BUILDING FSEP

Date	Revision	Notes
3/2025	Original document	Building FSEP first created, replaces EEOP
5/2024	Original document	This template is a modified version of the EH&S Fire Safety and Evacuation Plan template, revision 6.
7/2024	UWF Specified Disinfectant use	Page 16 Spill response
8/25/2023	Using revision 4 for 2023	Copied info over from previous template, updated Warden lists, other details
7/25/2022	Used latest template for 2022	Converted to FSEP from EEOP, using current template at the time
7/20	Revision 4	Undated links and minor editorial updates
6/2020	Revision 3	Revised to include COVID-19 (communicable disease) considerations during evacuation
1/2018	Revision 2	Updated links and minor editorial updates
12/2016	Revision 1	Section 5 revised to include evacuation waiting areas
4/2016	Original document	FSEP first created, replaces EEOP template

UW FACILITIES FSEP TEMPLATE REVISIONS

Date	Revision	Notes
5/2024	Original document	This template is a modified version of the EH&S Fire Safety and Evacuation Plan template, revision 6.
7/2024	UWF Specified Disinfectant use	Page 16 Spill response
7/2024	Remote worker	Page 6, item 7, responsibility of remote worker

SECTION 1: GENERAL INFORMATION

PURPOSE

The purpose of the Fire Safety and Evacuation Plan (FSEP) is to establish procedures required by Chapter 4 of the Seattle Fire Code for emergency planning and preparedness and Washington Administrative Code (WAC) 296-800-31075, procedures for sounding emergency alarms.

This FSEP Template is provided to UWF units to document how occupants of a building will be notified in an emergency, establish evacuation procedures and routes, provide support for persons with disabilities, and account for occupants. The template is designed to help units identify critical equipment that could pose a serious hazard to first responders, or present significant property loss risk if left in operation without an attendee, which can be provided to emergency responders for a safe and effective response.

In response to the COVID-19 pandemic, this plan integrates face covering and physical distancing preparedness with emergency evacuation procedures. The COVID-19 response considerations will also be applicable to any future communicable disease events with similar modes of transmission.

SECTION 2: RESPONSIBILITIES AND DUTIES

An effective Fire Safety and Evacuation Plan (“this plan”) requires the coordination of many occupants in a building. All building occupants, including faculty and other academic personnel, staff, students, and patients need to be aware of their roles and responsibilities in case of an emergency.

This section outlines specific responsibilities for University personnel, students, as well as the evacuation director and wardens. Visitors should also be instructed on proper response to alarms and the requirement to evacuate.

RESPONSIBILITIES OF STAFF, FACULTY AND OTHER PERSONNEL

1. Be familiar with building emergency procedures and act in the event of an emergency. Refer to Sections 3 and 4 of this plan.
2. Participate in drills and training as required.
3. Inform and assist visitors unfamiliar with building procedures as appropriate prior to and during an emergency.
4. Supervisors orient new employees of this plan upon hire.
5. Be familiar with guidelines herein to evacuate, take refuge, or stay in place if you are a person with mobility disabilities (refer to Section 5).
6. During a communicable disease outbreak, wear a face covering when inside a building and continue to wear it outside in designated evacuation area.
7. If working remotely during a major event (earthquake, city or statewide power outage, etc.), report your status to your supervisor as soon as possible by the agreed upon method and depending on the type of emergency, which may include phone call, text, email, sending a runner with the names of employees that need to be accounted for, etc.

RESPONSIBILITIES OF CLASSROOM TRAINERS AND INSTRUCTORS

1. Be familiar with building and emergency procedures and be prepared to provide direction to students attending your class in the event of an emergency.
2. Orient students with a brief [overview of emergency evacuation procedures](#) on the first day of class to:
 - a. Provide general information relating to emergency procedures, including locations of first aid kits, [AEDs](#) and fire extinguishers (Appendix C)
 - b. Inform students that evacuation is required when the alarm system is activated.
 - c. Inform students of the location of the nearest exits, and where to assemble outside.
3. Take responsible charge of the classroom during building emergencies and alarms.
4. Report an emergency by activating the alarm systems and calling 9-1-1.
5. Be familiar with evacuation options for persons with disabilities.

Plant Services Building

6. During a communicable disease outbreak, wear a face covering when inside a building and continue to wear it outside in designated evacuation area.

RESPONSIBILITIES OF EVACUATION DIRECTOR AND EVACUATION WARDENS

The evacuation director and evacuation wardens (and their alternates) who have been appointed (or have volunteered) to serve in these positions are both employed by the University and are building occupants. They receive special training from the Environmental Health & Safety Department (EH&S) to serve in their role. Additional information is available in Section 6.

EVACUATION DIRECTOR RESPONSIBILITIES

The [evacuation director](#) is the administrative lead for this plan and acts as the liaison with the responding emergency services in the event of a building emergency. If an emergency occurs when the evacuation director or their alternate is not available, an evacuation warden or a senior employee may serve as liaison.

Evacuation Directors: please check this [website](#) to assure it lists the most recent version of your FSEP. If you need to update the web version, contact your unit or department safety staff person or UWF Safety. Be sure to print a copy of this document and keep it with your emergency supplies and employee roster used for accounting for employees at the Evacuation Assembly Point (EAP).

EVACUATION DIRECTOR DUTIES

1. Administrative
 - a. Prepare, maintain and distribute the Fire Safety and Evacuation Plan (FSEP) to building occupants.
 - b. Work with management in all departments occupying the building to include the FSEP in [new employee orientation](#).
 - c. Call periodic meetings with evacuation wardens to review and update the FSEP.
 - d. Distribute the FSEP annually to all building occupants (those with assigned workstations) and highlight any changes to the document.
 - e. Be familiar with duties and emergency procedures.
2. Training
 - a. Evacuation Warden Training (Required): Complete the EH&S Evacuation Warden Training course at <http://ehs.washington.edu/training>.
 - b. Fire Extinguisher Training (Not required): Optional online and hands-on training courses on the use of portable fire extinguishers are available at <http://ehs.washington.edu/training>.
3. Preparation Guidelines

Plant Services Building

- a. Be familiar with the FSEP and all relevant emergency procedures. Coordinate with building/department administrators responsible for employee, student and visitor health and safety to ensure all units occupying the building are addressed in this plan.
 - b. Assist with the development of emergency procedures for persons with disabilities. Refer to guidelines contained in Section 5.
4. Oversee Evacuation Wardens
- a. Solicit volunteers or request that units/departments solicit volunteer evacuation wardens and alternates for all areas of the building. One way to ensure all areas have adequate coverage is to print out floor maps through the University of Washington Space Viewer application (maps.uw.edu/gis/home, NetID required).
 - b. Ensure wardens have attended EH&S Evacuation Warden Training course and know what their duties are in case of an emergency.
 - c. Ensure wardens are familiar with any existing UW face covering and physical distancing requirements or guidelines.
5. Planned Evacuation Drills
- a. Serve as liaison between building occupants, the building coordinator and EH&S for evacuation drills. EH&S is responsible for scheduling planned drills and will activate the fire alarm.
 - b. Critique the drill and complete the Drill Report Form, noting any problems or issues.
 - c. Download the [Drill Report Form](#) on the EH&S website.
 - d. Return completed forms to EH&S Building & Fire Safety (BFS), Box 354400 or email to evacdril@uw.edu.
6. Building Emergency Evacuation
- a. Wear a face covering (when required), evacuate and report to the evacuation assembly point and act as a building occupant liaison with responding emergency services.
 - b. Receive status reports from area evacuation wardens.
 - c. Identify yourself and communicate your role to incident command (usually the Seattle Fire Department on the Seattle campus) and provide any relevant information you may have about the status of the emergency.
 - d. Offer a hard copy of this plan and attachments to emergency services. Ask if they need any information about the building and help facilitate information sharing between occupants and emergency services.
 - e. Communicate with Environmental Health & Safety, UW Facilities (on the Seattle campus), personnel who work in the affected space and others who may have information.

Plant Services Building

- f. If necessary or requested by incident command, assign evacuation wardens or other personnel as needed to be stationed by all entrances to prevent unsuspecting personnel from reentering the building.
- g. When the fire department has communicated "ALL CLEAR," announce that occupants may re-enter the building. Do not allow re-entry if the alarm is silenced without confirmation of an all clear from emergency services.
- h. Coordinate with evacuation wardens to allow for a controlled reentry of building occupants to minimize crowding and ensure physical distancing (when required).

EVACUATION WARDEN DUTIES

1. Training

- a. Evacuation Warden Training (**Required**): Complete the EH&S [Evacuation Warden Training course](#).
- b. Participate in meetings with your evacuation director regarding your FSEP.
- c. Fire Extinguisher Training (**Not required**): Optional online and hands-on training courses on the use of portable fire extinguishers are available at ehs.washington.edu/training.

2. Preparation guidelines

- a. Be familiar with the FSEP and all relevant emergency procedures.
- b. Familiarize yourself with building exits and locations that are likely to have visitors or persons with disabilities who may need some assistance during a building emergency.
- c. Be aware of persons with mobility disabilities and their evacuation plan.
- d. Be familiar with your building alarm system and building safety features (general awareness) so that you may accurately interpret alarms.
- e. Become familiar with operations in your area that may require additional time to shut down and require occupant actions which would delay their exiting.
- f. Participate in evacuation drills as requested by the evacuation director.
- i. Inform persons with acknowledged mobility disabilities about the guidelines for evacuation (refer to Section 5). Contact EH&S for assistance.
- j. Be prepared to communicate to occupants outside of the building to keep them moving to the evacuation assembly point and to not obstruct roads or emergency responders.
- k. During a communicable disease outbreak, be prepared to communicate to occupants of the building to keep proper physical distancing between all other people at the evacuation assembly point and while reoccupying the building.

Plant Services Building

3. During a building emergency evacuation

- a. Check your area for visitors and others who may need assistance responding to the emergency. Students and visitors and other transient occupants who may not be familiar with how to evacuate should be informed of the location of the nearest exit. Direct occupants to the exits and tell them where to assemble outside.
- b. Direct persons with disabilities to follow their individual plan. If they don't have one, direct them to an area of refuge.
- c. Optional: Sweep your area by walking, calling out, knocking on doors and closing doors if possible as you exit the building. Encourage others to respond promptly. Be assertive when communicating the need to evacuate. If conducted, the sweep should not take longer than 2 minutes so that you will exit the building within 3 minutes.
- d. As a general rule, evacuation wardens should **not** fight fire with fire extinguishers or otherwise. Their primary role is to encourage occupants to move towards exits quickly and to communicate with the evacuation director at the evacuation assembly point.
- e. Exit the building and communicate with exiting occupants where to assemble outside. If fire or smoke is observed, wardens must discontinue their activities and evacuate immediately before the space becomes untenable.
- f. During a communicable disease outbreak, wear appropriate face covering.

4. At the evacuation assembly point

- a. Once outside, assertively direct people to the evacuation assembly point so they don't obstruct traffic or emergency responders. Remain at least 30 feet from the affected building.
- b. If you (or anyone from your area) have specific information about the nature or location of the emergency, immediately report the information to the evacuation director (via mobile phone or runner) who will relay the information to first responders at the incident command location.
- c. Account for all personnel as best you can. Attempt to identify persons who may have remained behind or were unable to evacuate. This is especially important if the building emergency is known and the persons unaccounted for work in or near the affected area. Confer with supervisors and co-workers and use any available lists or floor plans.
- d. Immediately report to the **evacuation director** any missing persons who you believe, or have reason to believe, may be in the building or in jeopardy.
- e. During a communicable disease outbreak, monitor for and communicate to building occupants regarding the use of face coverings and physical distancing (when required).
- f. When notified by the evacuation director, help communicate the "All Clear" message so the building may be reoccupied. Don't reoccupy in response to the alarm being silenced; await a definitive message.



Plant Services Building

- g. Coordinate with other evacuation wardens and the evacuation director to allow for a controlled reentry of building occupants.
- h. During a communicable disease outbreak, monitor and ensure building occupants wear their face coverings and maintain physical distancing (when required) while reentering the building.
- i. After the emergency event is over and the building occupants have re-entered, report to the Evacuation Director at the agreed location for debriefing.

SECTION 3: EVACUATION PROCEDURES

The evacuation procedures below are intended for building occupants to follow when there is a fire or other building emergency that requires evacuation.

1. Assume all alarms are real unless an announcement has been made just prior to the alarm.
2. During a communicable disease outbreak, put on a face covering (when required) when the alarm sounds.
3. Begin immediate evacuation of the building or area as outlined in Section 4 Emergency Procedures.
4. Take your keys and valuables.
5. Close doors behind you as you exit. Do not prop doors open; doors must remain closed to prevent smoke migration in the event of a fire.
6. Evacuate via the nearest stairwell or grade/ground level exit. Do not use an elevator. Do not go to the roof.
7. Go to your pre-determined evacuation assembly point, typically outdoors at a safe distance from the building and out of the way of emergency services. Note: Some high-rise buildings have indoor evacuation assembly points. Refer to Section 7 for specifics.
8. Persons with disabilities who are unable to evacuate will follow their personal plan to take refuge or report to an area of evacuation assistance (refer to section 5).

EVACUATION ROUTE MAPS

Occupants should go to the nearest exit when the alarm sounds. If access to the nearest exit is obstructed, an alternate exit should be taken.

Building [evacuation maps](#) are posted inside many University buildings to provide key evacuation route information in an emergency. Review the nearest evacuation map to the location where you will spend time in preparation for a building emergency.




KEY

- Evacuation Route
- ➔ Exits
- Emergency Assembly Points

Shuttles and Transportation Maintenance Physical Plant Building

1st Floor

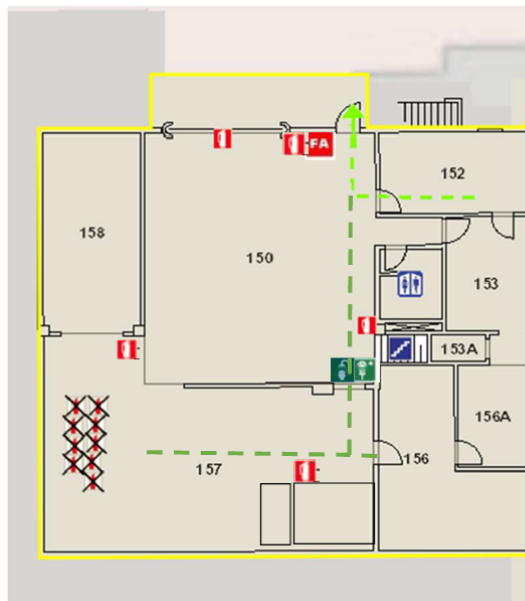

2nd Floor



KEY


- Evacuation Route
- ➔ Exits
- Fire Extinguisher
- Fire Alarm Pull Station
- Restrooms
- Eye wash station
- Emergency shower

Evacuation Assembly Point

1. Primary
2. Secondary



Emergency Assembly Point

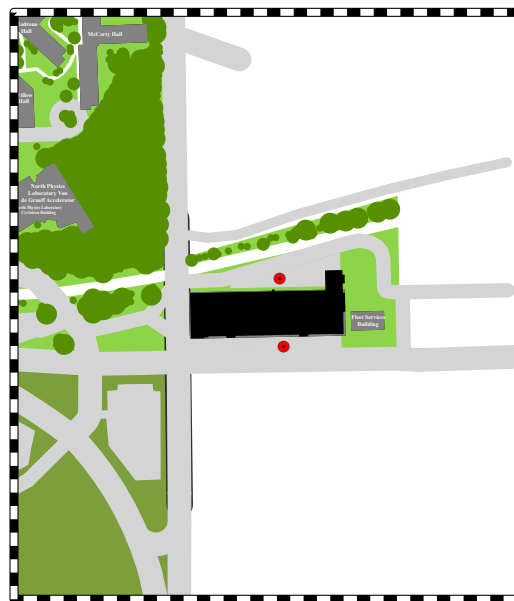

TS Shuttles/Maintenance Evacuation Assembly Point







KEY

- Evacuation Route
- Exits
- Emergency Assembly Points

Emergency Assembly Point

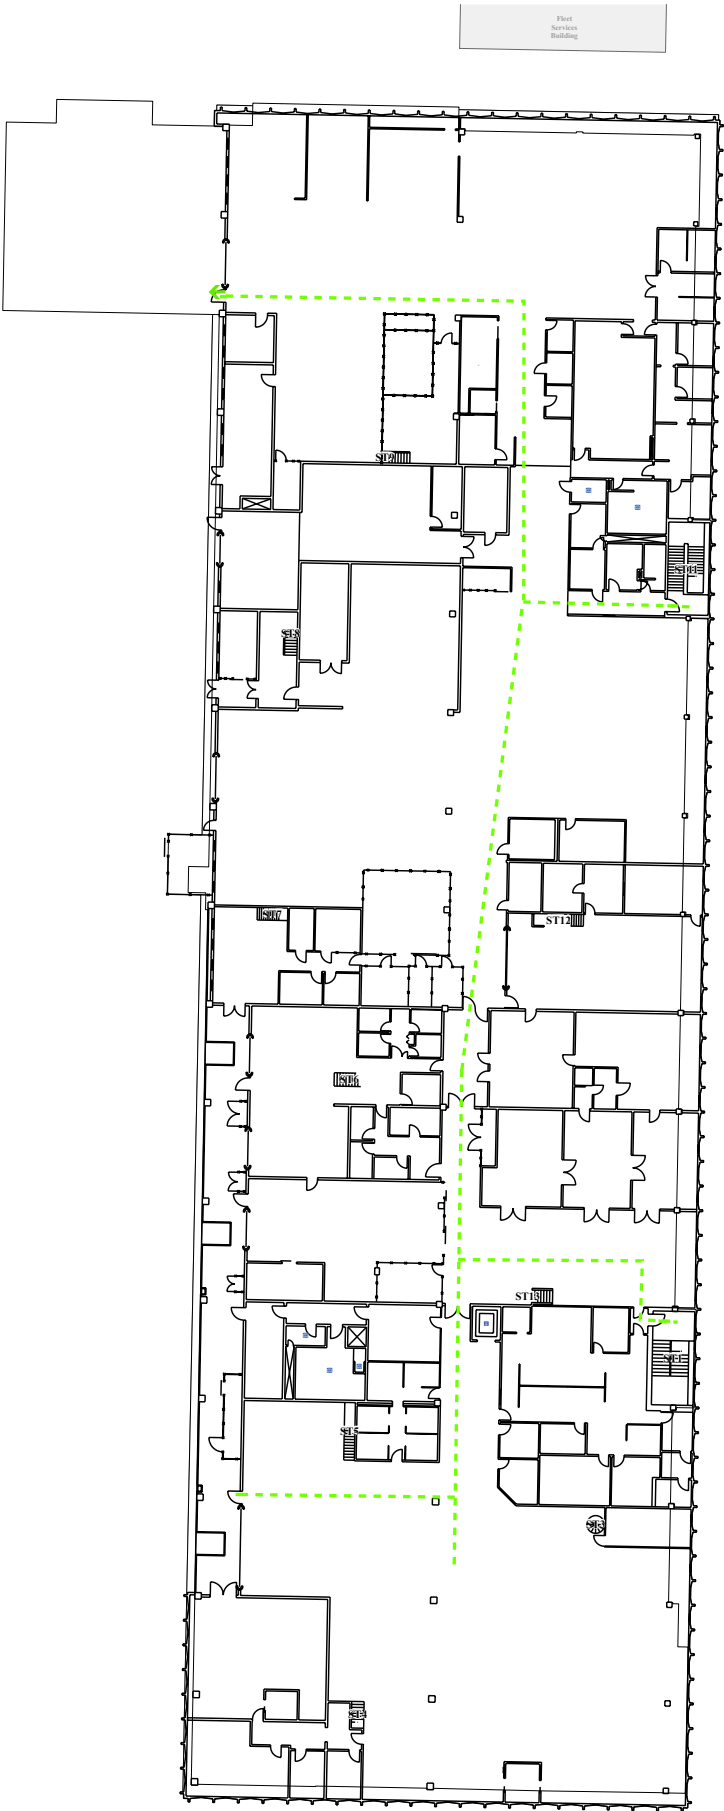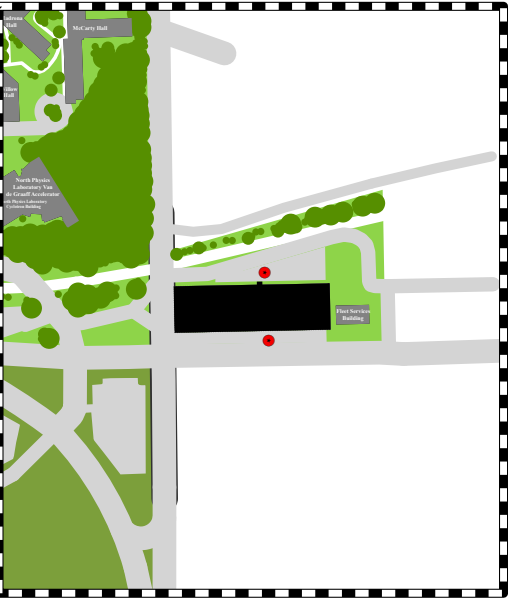

SECTION 4: EMERGENCY PROCEDURES

All fire alarm activations should be taken seriously. Building occupants must evacuate when the alarm sounds. **Never** assume it is a false alarm.

FIRE/EXPLOSION

- If something is on fire, use the **nearest pull station** to **activate the fire alarm**.
- **Call 9-1-1* (or TDD 206-543-3323)**. Communicate the details you know.
- **Use a fire extinguisher for small fires only**. Before you fight a fire, make sure that you:
 - Have **called 9-1-1** or pulled the fire alarm
 - Have been **trained** to use an extinguisher
 - Have an **evacuation route** planned
- If trapped by smoke or fire, **stay low** and try to **cover your mouth** with a wet cloth.
 - **Find a room** where you can **seal the cracks under the door** and **call 9-1-1**
 - If **near a window**, open but do **not break** it. **Wave or hang something outside** to alert fire personnel.
- If your clothes catch fire, **STOP, DROP and ROLL** to smother the flames.

* If calling '911' from a cell phone, the call will go to WA State Patrol 911 who can route your call to the proper agency (local police, fire, poison control, etc.) and/or let dispatcher know you are calling from UW and they can route you to UWPD. If calling from a campus landline, 911 routes to UWPD dispatch.

ALL FIRE ALARMS

- If you hear the fire alarm, **evacuate the building or area**. Close all doors as you go.
- Wear face covering if under communicable disease restrictions.
- **Do not use elevators**. Evacuate by using the **nearest stairwell**.
- **Go to your evacuation assembly point**. Refer to the evacuation map posted on each floor of the building if you do not know the location of your evacuation assembly point.
- Maintain physical distancing at the evacuation assembly point if required under communicable disease restrictions.
- **Report to the evacuation director** (preferred) or evacuation warden.

Plant Services Building

- **Do not re-enter the building** until authorized by emergency personnel.

If a fire occurs in a building without a fire alarm

- **Call out “FIRE – GET OUT”** loudly, using your voice **to inform other occupants**.
- **Call 9-1-1 (or TDD 206-543-3323)** and report the building name, address and specifics of the emergency.
- **Follow the general procedures listed above.**

REPORTING A FIRE

Report all unintended fires, including unintended open flames and smoke without a visible flame, to EH&S at uwfire@uw.edu or (206) 685-0341. Visit the [Fire Safety and Prevention page](#) for more information on reporting fires.

EARTHQUAKES

The danger and risks of earthquakes can be reduced if people know what actions to take before, during and after an earthquake.

The University provides the following instructions to help UW personnel, students and visitors prepare for responding to an emergency on the Seattle campus. University units and departments can modify these instructions for their specific location(s) and add them to their Fire Safety and Evacuation Plans.

IF YOU ARE INSIDE A BUILDING

- **Drop, cover and hold**
 - Under a desk, table or chair
 - In a corner or along the wall in a hallway away from windows
 - Near structurally strong locations such as a hall by a pillar
- **Do not use the elevators**
- **Watch for falling objects** such as light fixtures, bookcases, cabinets, shelves, and other furniture that might slide or topple.
- **Stay away from windows**
- **Do not run outside.** Exits may be damaged and the building's exterior brick, tile and decorations may be falling off. Be cautious; maintain awareness of your surroundings.

IF YOU ARE OUTSIDE A BUILDING

- **Stay outside.** Stay clear of electrical wires, poles, trees or anything that might fall.

AFTER A MAJOR EARTHQUAKE (MAGNITUDE 7.0 AND ABOVE)

- **Check for injuries to people in your area.** Do not attempt to move seriously injured persons unless they are in immediate danger. **Provide first aid** (if you are qualified).

Plant Services Building

- **Call 9-1-1** (or TDD 206-543-3323). Emergency services may not be able to respond for up to 72 hours.
- **Avoid areas of** hazardous material spills, gas leaks, fires and fallen objects.
- **Turn off ignition and heat sources** if it is safe to do so.
- **Exit the building** if structurally damaged, taking emergency/first-aid kit and personal belongings. Go to your evacuation assembly point. Report building damages and potentially hazardous conditions using the [Post-Earthquake Checklist](#) (Appendix F).
- **Do not re-enter a damaged building** until it has been declared safe by the University's Seismic building inspections [\(ATC\)-20](#) teams or other trained professionals.
- **Expect aftershocks** (i.e., smaller earthquakes that follow a larger one).

AFTER A MINOR EARTHQUAKE (BELOW 7.0 MAGNITUDE)

- **Restore calm** to those around you, if possible.
- **Examine your area for damage.** Staff members may use the [Post-Earthquake Checklist](#) (Appendix F) to make an *initial* assessment as to whether the building should remain occupied.
- **If obvious structural damage is identified**, evacuate the building and report observations to UW Police Department by calling 9-1-1.
- **Do not re-enter** buildings with structural damage until the building has been declared safe by the University's seismic building inspection [\(ATC-20\)](#) team or other trained professionals.
 - NOTE: Certain buildings will be evacuated for ALL earthquakes because of the potential damage of asbestos-containing building materials.
- **Check for chemical spills.** For small isolated spills, use spill cleanup procedures as outlined in EH&S's [Spill Response poster](#). If a chemical spill cleanup kit is not available, then evacuate the area and notify EH&S (206-543-0467 during business hours) or UWPD (206-685-UWPD after hours) to reach the EH&S staff on call. For larger spills, pull the fire alarm, evacuate the building and notify 9-1-1 (or TDD 206-543-3323) and EH&S.

HAZARDOUS MATERIAL SPILL OR RELEASE

A hazardous material spill is an uncontrolled release of a substance that is potentially hazardous to humans, animals and/or the environment. University personnel and students working with hazardous materials, including chemicals, biological agents and radiological materials, should be prepared to respond in the event a spill or release occurs.

The University provides the following instructions to help UW personnel, students and visitors prepare for responding to an emergency on the Seattle campus. University units and departments can modify these instructions for their specific location(s) and add them to their Fire Safety and Evacuation Plans.

EMERGENCY SPILLS OR RELEASES

If you cause or witness a hazardous material spill that endangers people or may lead to a fire, follow these emergency procedures:

- **Activate the fire alarm system.** Pull the nearest fire alarm to evacuate the building.
- **Call 9-1-1** (or TDD 206-543-3323) as soon as you are safe. **Report any details** you know about the spill:
 - **Location**
 - **Material and physical state** (e.g., liquid, powder)
 - **Quantity** spilled
 - Any known hazardous characteristics
- **Provide information** such as the **safety data sheet (SDS)** or a **chemical inventory** to the fire department once they arrive. The fire department will stabilize the spill but might not clean it up.
- **Follow the instructions on the [Spill Response Poster](#)** for biological, chemical and radiological releases (see page 17).
- **Follow the instructions on the [Exposure Response Poster](#)** if an exposure to hazardous materials has occurred (see page 18).
- After the incident, **schedule an exposure assessment** through the [UW Employee Health Center](#) (206-685-1026) or your personal healthcare physician.
- **Submit an incident report** to the University's [Online Accident Reporting System \(OARS\)](#).
- **Contact the Environmental Health & Safety Spill Line** at 206-543-0467 for assistance with contacting a spill cleanup contractor who will clean up and safely package the hazardous waste.
- **For regulated building material spills/disturbances, contact Regulated Materials Office at 206-685-3357 or uwrmo@uw.edu**

NON-EMERGENCY SPILLS

If the spill is contained and not endangering persons or property, it may be possible to clean it up yourself. Call the EH&S spill line at 206-543-0467 for advice during business hours (Monday through Friday, 8 a.m. to 5 p.m.). After business hours, call the UW Police Department non-emergency phone number at 206-685-UWPD.

Visit the [Spills webpage](#) on the EH&S website for more information.

SPILL RESPONSE POSTER

The most recent version of the **Spill Response Poster** is available on the Environmental Health & Safety website. **Note:** UW Facilities uses Ecolab disinfectants for biohazardous spills. Use per manufacturer's instructions.

ENVIRONMENTAL HEALTH & SAFETY
UNIVERSITY of WASHINGTON

W

SPILL RESPONSE

CALL 911 FOR ANY LIFE THREATENING EMERGENCY

IF EXPOSED, FOLLOW THE EXPOSURE RESPONSE POSTER

S.W.I.M. FOR ALL SPILLS

S: Stop the spill. Cover with absorbent material.

W: Warn others. Alert people in the immediate area of the spill.

I: Isolate the spill and secure the area. Close doors if possible.

M: Minimize your exposure by wearing PPE and avoiding contact, inhalation or ingestion. Vacate the area if necessary. Wash hands after handling spill materials.

RADIOLOGICAL SPILLS

- Utilize time, distance and shielding to prevent exposure.
- Cover with absorbent material.
- Wear gloves and use tongs/scoop to collect contaminated material as radioactive waste.
- Call UW Radiation Safety at **206.543.0463**. If office closed, **call 911**.
- Notify your supervisor.

CHEMICAL SPILLS

- If exposed, use the eye wash or safety shower for 15 minutes.*
- Large spills:** Pull the fire alarm and evacuate. EH&S can arrange for hazardous spill cleanup at the lab's expense.
- Small spills:** Trained personnel familiar with the chemical should use the lab's spill kit.
- Staff must protect themselves from skin, eye and respiratory hazards by using personal protective equipment (PPE) during cleanup.

EH&S chemical spill assistance is available 24/7:

- During business hours (Monday-Friday 8 a.m. to 5 p.m.), call **206.543.0467**.
- After business hours, call **206.685.UWPD (8973)** to reach EH&S staff on call.

BIOHAZARDOUS SPILLS

- Cover the spill with paper towels or absorbent material.
- Pour freshly prepared 10% bleach around the spill and allow to flow into spill.
- After 30 minutes of contact time, wipe up and dispose of as biohazard waste.
- Repeat procedure.

If spill contains recombinant nucleic acids, notify EH&S Biosafety as soon as possible at **206.221.7770**.

Report all spills within 24 hours via UW OARS: <https://oars.ehs.washington.edu>

February 2020
www.ehs.washington.edu

Plant Services Building

EXPOSURE RESPONSE POSTER

The most recent version of the **Exposure Response Poster** is available on the Environmental Health & Safety website.

ENVIRONMENTAL HEALTH & SAFETY
UNIVERSITY of WASHINGTON

EXPOSURE RESPONSE

for biological, chemical, or radiological exposures

W

CALL 911 FOR ANY LIFE THREATENING EMERGENCY

1. PERFORM FIRST AID

<p>Needlestick, puncture or sharps injury, or animal bite/scratch</p>	<p>Wash thoroughly for 15 minutes with warm water and sudsing soap.</p>
<p>Eye exposure</p>	<p>Use emergency station to flush eyes for 15 minutes while holding eyes open.</p>
<p>Skin exposure</p>	<ul style="list-style-type: none"> Radioactive: Survey skin and wash until the count rate cannot be reduced further. Stop if skin becomes irritated. Chemical: Wash with tepid water for 15 minutes. Hydrofluoric acid: Wash for 5 minutes, then apply calcium gluconate gel to skin. Biological: Wash with sudsing soap and water for 15 minutes.
<p>Inhalation or ingestion</p>	<ul style="list-style-type: none"> Move out of the contaminated area and seek fresh air. Do not induce vomiting unless instructed to do so. Radioactive: Blow nose into clean tissue and survey for contamination.

2. GET MEDICAL HELP

<p>For radiological exposure or emergency:</p>	<ul style="list-style-type: none"> Call Radiation Safety at 206-543-0463. Call 911 if office closed. Provide the radionuclide, estimated amount and time since exposure.
<p>For chemical exposure or emergency:</p>	<ul style="list-style-type: none"> Call 911 and follow the instructions given. Provide the chemical name, concentration, time since exposure and Safety Data Sheet (SDS).
<p>For biological and all other exposures:</p>	<ul style="list-style-type: none"> Call the Employee Health Center at 206-685-1026. Harborview sites call 206-744-3081. If closed, call 911 and follow the instructions given.
<p>For all exposures:</p>	<ul style="list-style-type: none"> Notify your supervisor. Secure the area before leaving.

3. REPORT THE INCIDENT

<p>For hospitalization, fatality, or recombinant nucleic acid exposure:</p>	<p>Notify EH&S immediately after performing first aid and getting medical help:</p> <ul style="list-style-type: none"> Call the EH&S main phone line at 206-543-7262. If closed, call 206-685-UWPD(8973) to reach EH&S staff on call.
<p>All incidents and near misses:</p>	<p>Submit a report via the UW Online Accident Report (OARS) within 24 hours at https://oars.ehs.washington.edu.</p>

September 2019

www.ehs.washington.edu

Plant Services Building

BOMB THREATS AND SUSPICIOUS MAIL

Report any threatening phone calls, mailed threats or suspicious packages immediately to police.

The University provides the following instructions to help UW personnel, students and visitors prepare for responding to an emergency on the Seattle campus. University units and departments can modify these instructions for their specific location(s) and add them to their Fire Safety and Evacuation Plans.

BOMB THREATS

- **Get as much information as possible (see Appendix E).**
 - Attempt to **learn the location where the bomb** is now or is going to be planted.
 - Try to **listen for information** about the caller.
 - **Listen for gender, accent and any other details.**
 - **Note any background noise** that may indicate the location of the caller.
 - Write down the **time of the call, phone number** where it came in and **who took the call.**
 - Make **note** of the **phone number** used to call you **if your phone has caller identification.**
- **Report the threat to police.**
 - **Call 9-1-1** (or TDD 206-543-3323) and report the threat and details to police.
 - **Follow instruction** provided by police.
 - **Report** the call **to your supervisor.**

SUSPICIOUS PACKAGES AND MAIL

Look for these signs:	A suspicious package may have:
<ol style="list-style-type: none"> 1. No return address 2. Restrictive markings, such as "PERSONAL" or "Confidential" 3. It is sealed with tape, especially if excessive amount. 4. The address: <ul style="list-style-type: none"> • has misspelled words • is addressed to a title, not a person • has an incorrect title • is badly typed or handwritten 	<ol style="list-style-type: none"> 1. Oily stains, discolorations or crystallizations on the wrapper 2. Strange odor 3. Excessive tape 4. Is rigid or bulky 5. Lopsided or uneven 6. The weight is odd for its size

Reference: US Postal Service Poster – <http://about.usps.com/posters/pos84.pdf>

Plant Services Building

If you find a suspicious package or letter:

1. Do not handle. Do not shake or bump
2. Isolate it immediately
3. Don't open, smell, touch, or taste
4. Treat it as suspect
5. Evacuate the area and **call 9-1-1** (or TDD 206-543-3323) from a safe location
6. Report the suspicious package to your supervisor

If you suspect the mail may contain...

1. **A bomb or explosive**
 - Evacuate immediately
 - Call 9-1-1 from a safe location
 - Notify your supervisor
2. **A radiological threat**
 - Limit exposure — do not handle
 - Evacuate area
 - Shield yourself from object
 - Call 9-1-1 from a safe location
 - Notify your supervisor
3. **A biological or chemical threat**
 - Isolate — do not handle
 - Evacuate the immediate area
 - Wash your hands with soap and warm water
 - Call 9-1-1 from a safe location
 - Notify your supervisor

If the letter or package has already been opened and a powder or other substance has spilled from it, **DO NOT CLEAN IT UP**. Leave it where it is, evacuate the area, wash your hands with soap and water and call 9-1-1 (or TDD 206-543-3323).

MEDICAL EMERGENCIES

Heart attack, choking, bleeding, poisoning, and burns, as well as other serious medical conditions, can happen anywhere. Prompt action and clear communication are vital when providing help.

The University provides the following instructions to help UW personnel, students and visitors prepare for responding to an emergency on the Seattle campus. University units and departments can modify these instructions for their specific location(s) and add them to their Fire Safety and Evacuation Plans.

Refer to a First Aid and CPR guide provided from UW Facilities approved training. These guides give detailed steps in the event of a heart attack, CPR and infant CPR, choking, bleeding, poisoning, and burns, as well as other injuries.

First aid/CPR training and certification are required for some UW Facilities employees. UW Facilities encourages all interested personnel who desire training to be trained in first aid/CPR procedures.

Plant Services Building

In the event of a sudden medical emergency

- **Stay calm.**
- **Assess the person.** Look on wrist, ankle or around neck for a medic alert bracelet or necklace.
- **Call 9-1-1** (or TDD 206-543-3323) **or have someone else do it.**
 - If you are alone, yell loudly for help.
 - If you are unable to summon help, call 9-1-1 *first* before assisting the person.
 - When calling 9-1-1 from a **landline** inside a Seattle campus building, the call will be routed directly to the UW Police Department. If you are using a **cellphone** to call 9-1-1, tell the operator you are at the University of Washington.
 - Give the operator as much information as possible, including:
 - Type of emergency
 - What help is needed
 - Exact address or building name
 - Room number or area
 - Your telephone number
 - Any information from medic alert bracelet or necklace
 - Victim information such as age and symptoms
 - **Don't hang up** until you are told to do so by the 9-1-1 operator.
 - **Do not move the victim** unless absolutely necessary. In many cases, moving the victim may cause additional trauma.
 - **Administer first aid or CPR** if you are qualified and current with your training.
 - **Follow universal precautions.** Treat all blood and body fluids as if they were known to be infectious for HIV, HBV, or other bloodborne pathogens.
 - **Look for an emergency contact phone number.** The contact number may be on the person's cellphone.
 - **Notify your supervisor of the event.**
 - **Report the incident.** Submit a report using the [Online Accident Reporting System \(OARS\)](#).

Plant Services Building

DEMONSTRATIONS / PROTESTS

Demonstrations and protests are common at universities. Most are peaceful attempts to raise awareness of a particular issue. Occasionally demonstrations may begin peacefully and then turn violent, resulting in property damage and personal injury.

The University provides the following instructions to help UW personnel, students and visitors prepare for responding to an emergency on the Seattle campus. University units and departments can modify these instructions for their specific location(s) and add them to their Fire Safety and Evacuation Plans.

Below are some guidelines on how to respond and react to demonstrations.

Interacting with demonstrators

- **Do not provoke**, obstruct, or get into verbal altercations with the demonstrators.
- **Move away from potentially dangerous areas** if a demonstration is becoming violent.

Maintaining security

- When you leave your office or lab always **close and lock doors**.
- **Do not allow others to follow you** into secured areas.
- **If necessary, have the building coordinator/facility manager secure your building or area:**
 - Lock exterior doors.
 - Reprogram your campus automated access management system (CAAMS).
- For scheduled demonstrations on the Seattle campus, **contact University Police Department** (206-685-8973) if you feel you will need **additional security**.

When to call 9-1-1 (or TDD 206-543-3323):

- If there is a **disruption to teaching, research, or work**
- If demonstrators **obstruct sidewalks or doorways**
- If you feel **threatened or passers-by are being harassed**
- If you **see suspicious, criminal or destructive activity**
- If **violence appears imminent or has erupted**

CRITICAL EQUIPMENT SHUTDOWNS

1. Critical equipment is defined as equipment that could pose a serious hazard to first responders, or present significant property loss risk if left in operation without an attendee. This does not include loss of research information or quality. Wardens should recognize that personnel attending critical equipment may not be able to immediately evacuate. It is a best

Plant Services Building

practice to provide this information and may not apply in many buildings. Contact EH&S for assistance.

There is no critical equipment in the Plant Services Building which requires shutdown in the event of an emergency evacuation.

2. List all equipment to be shutdown, if necessary. *See Appendix B*

ACTIVE SHOOTER

“Active shooter” refers to anyone armed and shooting at civilians, police or into an area where persons could be struck by random fire. As soon as it is safe, notify the police department.

The University provides the following instructions to help UW personnel, students and visitors prepare for responding to an emergency on the Seattle campus. University units and departments can modify these instructions for their specific location(s) and add them to their Fire Safety and Evacuation Plans.

IN A CLASSROOM, RESIDENCE HALL OR OFFICE

- **STAY THERE.** If you are in a safe place, stay put.
- **Secure the door.** If the door has no lock and the door opens in, use heavy furniture to barricade the door.
- **Cover windows.** If the door has a window, cover it if you can. Depending on the shooter’s location, consider exiting through windows. Have someone watch the door as you get as many out the windows (ground floor) as calmly and quietly as possible.
- **Stay low.** If you can’t exit through the windows, get out of sight from the door and stay low and quiet.
- **Silence cell phones** and other electronic devices.
- If no police units are on scene, **move away from the shooter.** Find safe cover and wait for the police to arrive.
- **When officers arrive** on scene, **move toward any law enforcement** personnel or a police vehicle when it’s safe. Keep your hands visible to police at all times.
- **Follow** all police directions exactly.

IN HALLWAYS OR CORRIDORS

Get to a nearby room and secure it. Unless you are close to an exit, do not attempt to run through a hallway, you may encounter the shooter.

IN LARGE ROOMS OR AUDITORIUMS

If remote from the shooter, exit the building and move toward any law enforcement personnel or a police vehicle. Keep your hands visible to police.

Plant Services Building

Open Spaces

Stay alert and look for cover, such as brick walls, large trees, retaining walls, parked vehicles or any other object that may stop gunfire rounds.

TRAPPED WITH THE SHOOTER

- **Do not provoke the shooter.** If no shooting is happening, do what the shooter says and do not move suddenly.
- **If the shooter starts shooting, try taking one of these decisive actions:**
 - **Freeze** and **stay very still**
 - **Run for an exit** while zigzagging. A moving target is harder to hit than a stationary one
 - **Attack the shooter. This is very dangerous**, but it may be less dangerous than doing nothing. The last thing the shooter will expect is to be attacked by an unarmed person.

More information: <https://police.uw.edu/active-shooter-guide/>

WORKPLACE VIOLENCE

Refer to the **Workplace Violence page** on the UW Human Resources website.

POWER OUTAGES

The University provides the following instructions to help UW personnel, students and visitors prepare for responding to an emergency on the Seattle campus. University units and departments can modify these instructions for their specific location(s) and add them to their Fire Safety and Evacuation Plans.

WHEN THE POWER GOES OUT

Visit [washington.edu/safety/alert](https://www.washington.edu/safety/alert), tune to KOMO 1000 AM, or call UW 206-547-INFO to get information about the situation. If conditions seem dangerous, evacuate the area and assist others to evacuate as needed. Do not re-enter a building until authorities have determined it safe to do so.

EMERGENCY LIGHTING

- Many buildings are equipped with emergency lighting systems that provide **minimal light for exiting**, not routine work. **Evacuate buildings** while these systems are still operating.
- Emergency **pathway lighting** is only designed to last about **90 minutes**.
- Some buildings on the Seattle campus may have emergency lighting for up to **eight hours** but **many have no emergency power at all**.

GENERAL PROCEDURES FOR ACADEMIC BUILDINGS

Plant Services Building

- **Assess** the extent of the outage in your area.
- **Remain calm**; provide assistance to others if necessary. Help co-workers in darkened work areas move to safe and lighted locations.
- **Exits** may be indicated by lighted signs if the emergency power is operating.
- **Report** the outage to your facility manager. On the UW Seattle campus, call **206-685-1411**.
- **Open blinds** for additional light.
- **Open windows** for improved ventilation, if needed.
- If possible, **shut off power** to machinery and equipment that could restart while unattended.
- **Don't use candles**, lanterns, charcoal, grills or anything that uses fuel inside a building.
- Don't bring **emergency generators** indoors or near building doors or windows.
- If you are **trapped in an elevator on the Seattle campus**, use the emergency call panel inside the elevator to call for help. Use your cellphone to call UW Facilities at 206-685-0200 if the emergency call panel is not working.
- **Evacuate** if the power is anticipated to be out for an extended period of time and work conditions are not safe or exit pathways are not lighted.

PROCEDURES FOR LABORATORIES, SHOPS, AND LOCATIONS WITH POTENTIALLY HAZARDOUS MATERIALS OR CONDITIONS

- **Shut down equipment** and preserve important work.
- Promptly **evacuate** areas with hazardous materials and equipment.
- If possible, cap any **open containers** of hazardous materials.
- Close sashes on **fume hoods** and **biological safety cabinets**.
- **Secure** any hazardous materials in transport.
- **Keep refrigerators and freezers closed** throughout the outage. If necessary, implement backup procedures such as obtaining dry ice for refrigerators.
- **When power is restored**, **assess** your area for potentially hazardous situations, such as devices left "on." Also do this if power is restored when the facility would normally not be occupied.
- **Review the UW Laboratory Safety Manual, Section 9**, for additional information.

PROCEDURES FOR ON-CAMPUS RESIDENTIAL BUILDINGS

Plant Services Building

Follow the procedures above and following instructions from UW Housing & Food Services (HFS).

Responses to types of power outages

The classification of unplanned power outages depends on several factors (expected duration of outage, time of day, time of year, etc.). In general, unplanned power outages can be broken down in terms of severity and probable emergency actions, as follows:

- Minor impacts to individual rooms or small buildings, for periods usually not exceeding 1 day
 - Emergency actions typically include the temporary relocation of directly affected personnel (as necessary) until repairs can be made by facilities management.
- Impacts to a small number of buildings for periods exceeding 1 day, or where the outage impairs life safety or heating system needs
 - Assuming the needs of displaced or impacted personnel can be met on campus, emergency actions typically include the temporary relocation of students in affected buildings to other on-campus facilities, and employees being given alternative work assignments or sent home until repairs can be made by facilities management.
- Multi-day or multi-building impacts, where the outage impairs life safety or heating system needs
 - Assuming the needs of displaced or impacted personnel cannot be met on campus, emergency actions typically include the temporary relocation of students in affected buildings to other off-campus facilities, and employees being given alternative work assignments or sent home until repairs can be made by facilities management or the utility supply vendor.

ELEVATOR FAILURE

Elevators are one of the safest forms of transportation; however, it is important to be prepared to help ensure passenger safety in the event an elevator stops working.

The University provides the following instructions to help UW personnel, students and visitors prepare for responding to an emergency on the Seattle campus. University units and departments can modify these instructions for their specific location(s) and add them to their Fire Safety and Evacuation Plans.

If there is a fire or power outage

- **Never use an elevator if a fire alarm has been activated.**
- Most elevators will automatically go to a **designated floor**.
- Elevators are likely to be **out of service** in the event of a power failure.
- **Emergency lighting will come on** inside an elevator if there is a power failure.

Plant Services Building

If YOU ARE trapped in an elevator

- **Do not panic.** There is plenty of air in the elevator.
- **Don't pry open closed doors** to attempt to climb out.
- **Push the "bell" or "alarm" button** to alert people outside that there is a problem.
- Use the **emergency call panel** inside the elevator to call for help.
 - Use your cellphone to **call UW Facilities at 206-685-0200** if the emergency call panel is not working. If your signal is weak, **text a friend** and ask them to call UW Facilities.
- Call 9-1-1 (or TDD 206-543-3323) *in case of fire or medical emergency only.*

If YOU ARE HELPING others trapped in an elevator

- **Listen** for a bell or alarm sound, or voices in the elevator. If you can communicate with the trapped individual(s), find out their condition.
- Call 206-685 0200 to reach UW Facilities **24 hours a day.**
- Reassure the people who are trapped that help is on the way.
- Call 9-1-1 *in case of fire or medical emergency only.*

If an elevator has stopped working AND no passengers are inside

- **Notify the building coordinator** or call UW Facilities at 206-685-0200.
 - Provide the location and details of the issue.
 - Let them know if the elevator outage is preventing individuals with limited mobility from exiting the building.
- Call 9-1-1 *in case of fire or medical emergency only.*

PLUMBING PROBLEMS AND FLOODING

Adverse weather or broken pipes can lead to leaks, floods and other plumbing problems. Serious water damage to University buildings not only disrupts research and campus operations but also can lead to mold and mildew problems.

FLOODING

- In **non-emergency** situations, **notify the building coordinator** or call Facilities at 206-685-1411.
- **ALWAYS** check all doors for warning signs before entering effected areas, even if the door is propped open.
- **Confirm** you are authorized by the occupying department to enter the space.
- If you can **safely** find the flooding source, **shut off the flow of water.**

WORK SAFE, HOME SAFE

Plant Services Building

- **Standing water**, if near a source of electricity, can pose an **electrocution hazard**.
 - **Stop using electrical equipment immediately.**
 - **Turn the equipment off**, but only if you can do it **safely**.
 - **Evacuate and call 911**
- If **chemical or biological hazards** are involved or suspected, **contact EH&S** at 206-543-7262.
- If **asbestos-containing material** (or any regulated material) is damaged, contact Facilities Services at 206-685-1411.

WATER SERVICE INTERRUPTED

Notify your building coordinator or call Facilities at 206-685-1411.

OTHER EMERGENCY PROCEDURES

Building emergency procedures for a variety of emergencies are located on the [EH&S website](#).

A printed copy of this FSEP is available at Maintenance & Construction's Northeast Zone's administrative office in Room 256 and at the Director of Maintenance & Construction office in Room 204.

SECTION 5: EMERGENCY EVACUATION FOR PERSONS WITH DISABILITIES

This section provides a general guideline of evacuation procedures for persons who may have difficulty exiting during building evacuations. Personnel, students and visitors with disabilities are expected to consider their [evacuation options](#) in advance to determine their best response to a building emergency. Assistance is available through [UW Environmental Health & Safety](#) (EH&S), the [Disability Services Office](#) (for personnel) and [Disability Resources for Students](#).

PLANNING

Persons with mobility disabilities are encouraged to:

1. Consider evacuation options for each building they occupy.
2. Identify a volunteer who will be responsible for communicating with emergency services on their behalf during a building emergency.
3. Document their evacuation plans and provide them to the building evacuation director who will inform evacuation wardens and retain it for reference. [A template is available for download](#) at the EH&S website.
4. Keep a face covering on their person at all times if required under communicable disease restrictions.

EVACUATION OPTIONS

Persons with disabilities have five [evacuation options](#), listed below in order of safety. This information is primarily to address evacuation for persons with mobility disabilities.

1. **Exit the building (safest option):** Use accessible routes to exit the building if the route appears safe. Note that the accessible route may not always be via the nearest exit.
2. **Move to a safer part of the building:** In large buildings and multi-wing complexes, such as the Health Sciences Building on the Seattle campus, you may be able to evacuate horizontally to an unaffected wing or area where the alarm is not sounding.
3. **Move to an area of refuge:** An area of refuge is a designated area inside a building that is equipped with two-way communications with the UW Police Department and where you can safely remain in place during a building evacuation. Check the [evacuation map](#) posted in each building or call EH&S at 206-616-5530 to locate an Area of Refuge.
4. **Use an assisted evacuation device:** An assisted evacuation device, such as a specially designed chair, can be used by trained personnel to evacuate people with mobility disabilities.

Plant Services Building

5. **Stay in place (least safe option):** It may be appropriate for an individual who is unable to exit the building to stay in place in the following areas:
- A **building stairwell** that has a large landing. Wait near the exit stairwell until everyone has evacuated the floor and traffic has cleared before entering the stairwell.
 - **Enclosed elevator lobbies**
 - **Fire-rated exit corridors**, especially when close to an exit.
 - **An enclosed room with an exterior window, a telephone and a solid or fire resistant door.** With this option, you may keep in contact with emergency services by dialing 9-1-1 and reporting your location directly. Emergency services will relay this location to on-site emergency personnel who will determine the need for evacuation.

Elevators can be unsafe to use in an emergency and in most buildings they are automatically recalled to the ground floor. Emergency personnel have special keys to override the elevator functions and can use them to assist with evacuation.

EMERGENCY PROCEDURES

1. Persons with mobility disabilities should evacuate (if able), report to an area of refuge (if available), or stay in place in the event of an emergency requiring evacuation or when the building alarm system is activated.
2. If reporting to an area of refuge or staying in place, contact emergency services by calling 9-1-1 and inform them of your plans.
3. Volunteers may assist persons with disabilities reach an area of refuge but should evacuate and go to the evacuation assembly point and report to emergency services the location and status of the person with disabilities.
4. During a communicable disease outbreak, a person who is assisting another person may be required to have a higher level of personal protective equipment (PPE) due to the time spent in close contact with another person. If this is part of the disabled individual's evacuation plan, an evacuation kit with goggles and surgical masks should be provided for both the disabled person and their helper to be used in the event of an evacuation during a communicable disease outbreak.
5. The evacuation director should provide any relevant information to emergency services.

OTHER DISABILITIES

Persons with visual, hearing, cognitive or other disabilities are encouraged to consult with and seek accommodation through the [Disability Services Office](#) (for personnel) or [Disability Resources for Students](#).

Plant Services Building

Areas of refuge and/or evacuation waiting areas

Location	Description
None	All occupants are to exit the building immediately and proceed to assembly locations.
See site specific plan	For those with disabilities, please refer to your site-specific plan for area of refuge.

Plant Services Building

SECTION 6: BUILDING-SPECIFIC INFORMATION OF EMERGENCY COMMUNICATIONS

The following is used to describe the method used to notify first responders of an emergency within our building.

- ☒ Our building is equipped with a **monitored** fire alarm system. In the event of a fire alarm activation, signals are sent to the UW Police Department and a central monitoring station that notifies the Seattle Fire Department. Evacuate and call 9-1-1 (or TDD 206-543-3323) to report specific information about the emergency.
- ☐ Our building is equipped with a fire alarm system that is **not monitored**. Call 9-1-1 (or TDD 206-543-3323).
- ☐ Our building is **not** equipped with a fire alarm system. Call 9-1-1 (or TDD 206-543-3323).

The fire alarm system notification **audible** tone is (refer to the [FSEP instructions](#)) a:

- ☐ Slow whoop
- ☐ Temporal 3
- ☒ Solid tone
- ☐ NA, no fire alarm

The fire alarm system **visual** notification is:

- ☒ **Strobe**

Plant Services Building

SECTION 7: EVACUATION METHODS & ASSEMBLY LOCATIONS

BUILDING EVACUATION

The building fire alarm system is designed for:

- ☐ **No Fire Alarm.** There is no fire alarm system. The entire building evacuates for fire and other emergencies as outlined in the building emergency procedures.
- ☒ **Complete Building Evacuation.** All occupants evacuate to exterior of building for fire and other emergencies as outlined in the building emergency procedures.
- ☐ **Partial and/or Phased Evacuation.** Occupants of alarmed areas may evacuate to an indoor evacuation assembly point, typically at a location several floors below the alarmed and affected area and separate from fire fighter staging areas (common to high rise buildings). Occupants are instructed to exit down the stairwell onto a predetermined floor where the alarm is not sounding. Some occupants near grade level may evacuate to the exterior. A subsequent alarm may require additional evacuations if deemed necessary by the fire service.

[Refer to [FSEP instructions](#). If partial or phased evacuation applies, a specific plan should be described here either using a narrative or in tabular form to replace or edit the paragraph above. Contact EH&S for assistance.]

OUTDOOR EVACUATION ASSEMBLY POINT (EAP)

The Evacuation Assembly Point (EAP) should be an open area at least 30 feet away from the building and out of the way of responding emergency personnel. Occupants meet after evacuation so that they may be accounted for or lend assistance as needed.

There may be more than one assembly point depending on the size of the building and the location of the exits. List the EAP locations and indicate which areas of the building are to report to which area. *[A map of available EAPs can be found on the [EH&S website](http://www.ehs.washington.edu/system/files/resources/eapmap.pdf) at www.ehs.washington.edu/system/files/resources/eapmap.pdf.] Also refer to the [list](#) for UW Mass Assembly Areas and [Map](#)*

EAP Location	Serves those exiting from:
West of Parking Lot N-26 (Along Burke-Gilman)	Building Envelope Facilities Construction M&C Administration Customer Care Team

Plant Services Building

	<p>Northeast Zone</p> <p>Preventive Maintenance</p> <p>Regulated Materials Admin</p>
<p>East of Parking Lot N-26</p> <p>(Along 25th Avenue NE)</p>	<p>UW Facilities Training Center</p> <p>UW Facilities Safety</p> <p>UW Facilities Stores</p> <p>Regulated Materials (Industrial Hygienists)</p> <p>Kanway</p> <p>Moving & Surplus</p>
<p>Parking Lot N-25</p> <p>(south of Pend Oreille Road NE)</p>	<p>Secondary EAP for all departments</p>

Plant Services Building

SECTION 8 - EVACUATION DIRECTOR AND WARDENS

Last Updated (date): 03/2025

Floor	Assigned Area	Evacuation Director Name	Email	Cell Phone
2	Whole building	Primary - Steve Snyder	srsnyder@uw.edu	(206)910-4267
		Alternative - Eric Yerxa	yerxae@uw.edu	(206)396-1271
Floor	Assigned Area	Evacuation Warden Name	Email	Cell Phone
2	North end, Shop 15	Primary – Scott Meyering	scottm52@uw.edu	(206)255-8940
		Alternate – Manny Chacin	mchacin@uw.edu	(206)396-0012
2	North end, night shift, Shop 41	Primary – Steven Vasquez	segy@uw.edu	(206)396-2738
		Alternate – Richard Chapman	RC53@uw.edu	(206)437-8263
2	Mid floor, night shift, Shop 53	Primary - Theo Schmitz	Ts37@uw.edu	(206)661-2548
		Alternate – Jennifer Greeley	jg57@uw.edu	(206)291-6894
2	Mid floor, west side, Shop 54	Primary - John Eckhouse	jkhhouse@uw.edu	(425)773-1681
		Alternate – Pam Honegger	Pamh92@uw.edu	(206)221-5301
2	Mid floor, east side, Shop 56	Primary – Andy Clark	andclark@uw.edu	(206)221-2565
		Alternate – Pam Honegger	Pamh93@uw.edu	(253)221-5301
1	Stores	Primary – Sergio Escobedo	Serge5@uw.edu	(206)388-8202

Plant Services Building

		Alternate – Arne Nestegard	arnen@uw.edu	(206)685-8561
1	Moving / Surplus	Primary - Jeanel Cassidy	jeanel@uw.edu	(206)724-2156
		Alternate – Arne Nestegard	arnen@uw.edu	(206)685-8561
1	Shuttles / Parking Maintenance, North end	Primary – Cynthia Conroy	Cconroy@uw.edu	(425)895-8938
		Alternate Derek Martin	martindt@uw.edu	(206)240-4519
1	Kanway	Primary - Doug Mensching	Doug@fsandgs.com	(253)606-7654
		Alternate – Saeid Rastegar	Rastegar@uw.edu	(206)910-5781
1	Facilities Safety	Primary – Page Russell	peidj@uw.edu	(206)616-5657
		Alternate – Sarah Lewis - Assink	sarahla1@uw.edu	(253)266-3817
1	Training Center, separate EEOP submitted	Primary – Page Russell	peidj@uw.edu	(206)616-5657
		Alternate – Sarah Lewis-Assink	sarahla1@uw.edu	(253)266-3817
2	SE corner, Shop 18	Primary - Todd Winkler	toddw4@uw.edu	(206)734-5932
		Alternate		
2	North end, Shop 10	Primary - Charles Thompson	Clthomp@uw.edu	(206)255-5061
		Alternate		
2	Mid floor east side plus annex, Shop 32, Dan Schwert, Russell Browne, Saied Rastegar	Primary - Dan Schwert	Schwertd@uw.edu	(206)491-6076
		Alternate – Russell Browne	Rbrowne2@uw.edu	(206)890-6494

Plant Services Building

2	NE quadrant near overhead door, Shop 52	Primary – David Horne	Dh42@uw.edu	(206)495-1879
		Alternate – Mark Pekarek	Pekarm@uw.edu	(206)696-4954
2	NW quadrant, Care Team and Executive Offices	Primary – Rick Trowbridge	Ricktrow@uw.edu	(206)685-1775
2		Alternate – Jim Mazurk	Mazurk@uw.edu	(206)795-1965
1	Facilities IT, adjacent to Stores	Primary – Sergio Escobedo	Serge5@uw.edu	(206)388-8202

APPENDIX A: MYCHEM CONTACTS REPORTS

The Location Contact Report or Inventory Contact Report from [MyChem](#) is appended to this plan to provide a list of responsible parties and contact information for laboratories, shops and other areas that store and use chemicals and compressed gases.

The Inventory Contacts Report found in MyChem can provide specific contact information to emergency responders. Additionally, the contact information should match what is on the MyChem Caution Sign on the entrance(s) to each room where chemicals/compressed gases are stored. Those who are already designated as Responsible Persons for their shop's chemical inventory in MyChem are the only ones that have full access to their specific shop's chemical inventories.

From the MyChem main menu, select Report and in the drop-down menu, select Inventory Contacts or Contacts and Users. Fill in Department field.

UWF Shops are listed in MyChem under the Department field as "UWF-unit & shop number". For example, UWF-ARCF Shop 26, UWF-BSD Shop 89, UWF-CEUO Shop 50, UWF-MC Shop 10, UWF-TS Shop 86, etc.

Select 'PDF Report' or 'CSV File' (for an editable spreadsheet format). The report will pop up in a new window/tab.

If you do not have access to the MyChem inventory for your shop, contact Chris Pennington (UW Facilities MyChem administrator) at pennnc23@uw.edu or 206-685-4052.

If you need help with MyChem or the report, you may contact Chris Pennington or contact EH&S at 206-616-4046 or mychem@uw.edu.

Plant Services Building

Department	Room	Area	Contacts	Role	Work Phone	Emergency Phone	Number of Chems	Access Level
UWF-BSD SHOP 89	106	PSB1	JEFFERY DWAYNE DALE	RP	206-391-2787		6	Inventory Owner
UWF-BSD SHOP 89	114A	PSB1	JEFFERY DWAYNE DALE	RP	206-391-2787		6	Inventory Owner
UWF-BSD SHOP 89	213	PSB2	JEFFERY DWAYNE DALE	RP	206-391-2787		6	Inventory Owner
UWF-BSD SHOP 89	240	PSB2	JEFFERY DWAYNE DALE	RP	206-391-2787		6	Inventory Owner
UWF-MC SHOP 10	247	PSB2	CHARLES L THOMPSON	RP	206-221-7119	206-255-5061	171	Inventory Owner
UWF-MC SHOP 10	247A	PSB2	CHARLES L THOMPSON	RP	206-221-7119	206-255-5061	1	Inventory Owner
UWF-MC SHOP 10	247CAGE	PSB2	CHARLES L THOMPSON	RP	206-221-7119	206-255-5061	27	Inventory Owner
UWF-MC SHOP 10	253	PSB2	CHARLES L THOMPSON	RP	206-221-7119	206-255-5061	37	Inventory Owner
UWF-MC SHOP 10	253CAGE	PSB2	CHARLES L THOMPSON	RP	206-221-7119	206-255-5061	9	Inventory Owner
UWF-MC SHOP 10	YELLOW CAGE	PSBX	KENNETH F CLARK	Area	206-554-1412		3	Inventory Access
UWF-MC SHOP 10	YELLOW CAGE	PSBX	CHARLES L THOMPSON	RP	206-221-7119	206-255-5061	3	Inventory Owner
UWF-MC SHOP 14	231G	PSB2	ROBIN M. SHOEMAKE	Area	206-221-7820		52	Inventory Access
UWF-MC SHOP 14	231G	PSB2	JEFFREY J. KOPEC	RP	206-221-3127	206-465-5339	52	Inventory Owner

Plant Services Building

UWF-MC SHOP 15	251 FLAMM CAB	PSB2	RICHARD M. DIERCK	Area	206-543-8411		93	Inventory Access
UWF-MC SHOP 15	251 FLAMM CAB	PSB2	STEVEN R SNYDER	RP	206-221-2884		93	Inventory Owner
UWF-MC SHOP 15	251	PSB2	RICHARD M. DIERCK	Area	206-543-8411		190	Inventory Access
UWF-MC SHOP 15	251	PSB2	STEVEN R SNYDER	RP	206-221-2884		190	Inventory Owner
UWF-MC SHOP 15	251C	PSB2	RICHARD M. DIERCK	Area	206-543-8411		2	Inventory Access
UWF-MC SHOP 15	251C	PSB2	STEVEN R SNYDER	RP	206-221-2884		2	Inventory Owner
UWF-MC SHOP 15	251CAGE	PSB2	RICHARD M. DIERCK	Area	206-543-8411		5	Inventory Access
UWF-MC SHOP 15	251CAGE	PSB2	STEVEN R SNYDER	RP	206-221-2884		5	Inventory Owner
UWF-MC SHOP 15	251WELDING	PSB2	RICHARD M. DIERCK	Area	206-543-8411		47	Inventory Access
UWF-MC SHOP 15	251WELDING	PSB2	STEVEN R SNYDER	RP	206-221-2884		47	Inventory Owner
UWF-MC SHOP 15	255	PSB2	RICHARD M. DIERCK	Area	206-543-8411		4	Inventory Access
UWF-MC SHOP 15	255	PSB2	STEVEN R SNYDER	RP	206-221-2884		4	Inventory Owner
UWF-MC SHOP 15	STLTIFT	PSB2	RICHARD M. DIERCK	Area	206-543-8411		28	Inventory Access
UWF-MC SHOP 15	STLTIFT	PSB2	STEVEN R SNYDER	RP	206-221-2884		28	Inventory Owner
UWF-MC SHOP 15	VAN024	PSBV	RICHARD M. DIERCK	Area	206-543-8411		0	Inventory Access

Plant Services Building

UWF-MC SHOP 15	VAN024	PSBV	STEVEN R SNYDER	RP	206-221-2884		0	Inventory Owner
UWF-MC SHOP 15	VAN086	PSBV	RICHARD M. DIERCK	Area	206-543-8411		7	Inventory Access
UWF-MC SHOP 15	VAN086	PSBV	STEVEN R SNYDER	RP	206-221-2884		7	Inventory Owner
UWF-MC SHOP 15	VAN096	PSBV	RICHARD M. DIERCK	Area	206-543-8411		18	Inventory Access
UWF-MC SHOP 15	VAN096	PSBV	STEVEN R SNYDER	RP	206-221-2884		18	Inventory Owner
UWF-MC SHOP 15	VAN14031	Not Set	STEVEN R SNYDER	RP	206-221-2884		3	Inventory Owner
UWF-MC SHOP 15	VAN303	PSBV	RICHARD M. DIERCK	Area	206-543-8411		7	Inventory Access
UWF-MC SHOP 15	VAN303	PSBV	STEVEN R SNYDER	RP	206-221-2884		7	Inventory Owner
UWF-MC SHOP 15	VAN403	PSBV	RICHARD M. DIERCK	Area	206-543-8411		28	Inventory Access
UWF-MC SHOP 15	VAN403	PSBV	STEVEN R SNYDER	RP	206-221-2884		28	Inventory Owner
UWF-MC SHOP 15	VAN461	PSBV	RICHARD M. DIERCK	Area	206-543-8411		14	Inventory Access
UWF-MC SHOP 15	VAN461	PSBV	STEVEN R SNYDER	RP	206-221-2884		14	Inventory Owner
UWF-MC SHOP 15	VAN674	PSBV	RICHARD M. DIERCK	Area	206-543-8411		16	Inventory Access
UWF-MC SHOP 15	VAN674	PSBV	STEVEN R SNYDER	RP	206-221-2884		16	Inventory Owner
UWF-MC SHOP 15	VEH047	PSBV	RICHARD M. DIERCK	Area	206-543-8411		2	Inventory Access

Plant Services Building

UWF-MC SHOP 15	VEH047	PSBV	STEVEN R SNYDER	RP	206-221-2884		2	Inventory Owner
UWF-MC SHOP 15	VEH14003	PSBV	RICHARD M. DIERCK	Area	206-543-8411		7	Inventory Access
UWF-MC SHOP 15	VEH14003	PSBV	STEVEN R SNYDER	RP	206-221-2884		7	Inventory Owner
UWF-MC SHOP 15	VEH14022	PSBV	RICHARD M. DIERCK	Area	206-543-8411		2	Inventory Access
UWF-MC SHOP 15	VEH14022	PSBV	STEVEN R SNYDER	RP	206-221-2884		2	Inventory Owner
UWF-MC SHOP 15	VEH24002	PSBV	RICHARD M. DIERCK	Area	206-543-8411		17	Inventory Access
UWF-MC SHOP 15	VEH24002	PSBV	STEVEN R SNYDER	RP	206-221-2884		17	Inventory Owner
UWF-MC SHOP 15	VEH24004	PSBV	RICHARD M. DIERCK	Area	206-543-8411		10	Inventory Access
UWF-MC SHOP 15	VEH24004	PSBV	STEVEN R SNYDER	RP	206-221-2884		10	Inventory Owner
UWF-MC SHOP 15	VEH24010	PSBV	RICHARD M. DIERCK	Area	206-543-8411		12	Inventory Access
UWF-MC SHOP 15	VEH24010	PSBV	STEVEN R SNYDER	RP	206-221-2884		12	Inventory Owner
UWF-MC SHOP 15	VEH310	PSBV	RICHARD M. DIERCK	Area	206-543-8411		2	Inventory Access
UWF-MC SHOP 15	VEH310	PSBV	STEVEN R SNYDER	RP	206-221-2884		2	Inventory Owner
UWF-MC SHOP 15	VEH439	PSBV	RICHARD M. DIERCK	Area	206-543-8411		17	Inventory Access
UWF-MC SHOP 15	VEH439	PSBV	STEVEN R SNYDER	RP	206-221-2884		17	Inventory Owner

Plant Services Building

UWF-MC SHOP 15	VEH444	PSBV	RICHARD M. DIERCK	Area	206-543-8411		7	Inventory Access
UWF-MC SHOP 15	VEH444	PSBV	STEVEN R SNYDER	RP	206-221-2884		7	Inventory Owner
UWF-MC SHOP 15	VEH970	PSBV	RICHARD M. DIERCK	Area	206-543-8411		2	Inventory Access
UWF-MC SHOP 15	VEH970	PSBV	STEVEN R SNYDER	RP	206-221-2884		2	Inventory Owner
UWF-MC SHOP 18	203B	PSB2	Todd Winkler	RP	206-221-4903	206-734-5932	30	Inventory Owner
UWF-MC SHOP 18	205	PSB2	Todd Winkler	RP	206-221-4903	206-734-5932	46	Inventory Owner
UWF-MC SHOP 18	205A	PSB2	Todd Winkler	RP	206-221-4903	206-734-5932	22	Inventory Owner
UWF-MC SHOP 18	LDOCK WEST	PSBX	Todd Winkler	RP	206-221-4903	206-734-5932	35	Inventory Owner
UWF-MC SHOP 18	TOP CONNEX	PSBX	Todd Winkler	RP	206-221-4903	206-734-5932	13	Inventory Owner
UWF-MC SHOP 18	VEH 14032	PSBV	Todd Winkler	RP	206-221-4903	206-734-5932	12	Inventory Owner
UWF-MC SHOP 18	VEH206	PSBV	Todd Winkler	RP	206-221-4903	206-734-5932	0	Inventory Owner
UWF-MC SHOP 18	VEH291	PSBV	Todd Winkler	RP	206-221-4903	206-734-5932	1	Inventory Owner
UWF-MC SHOP 18	VEH407	PSBV	Todd Winkler	RP	206-221-4903	206-734-5932	13	Inventory Owner
UWF-MC SHOP 18	VEH409	PSBV	Todd Winkler	RP	206-221-4903	206-734-5932	6	Inventory Owner
UWF-MC SHOP 18	VEH433	PSBV	Todd Winkler	RP	206-221-4903	206-734-5932	9	Inventory Owner

Plant Services Building

UWF-MC SHOP 18	VEH447	PSBV	Todd Winkler	RP	206-221-4903	206-734-5932	9	Inventory Owner
UWF-MC SHOP 18	VEH665	PSBV	Todd Winkler	RP	206-221-4903	206-734-5932	0	Inventory Owner
UWF-MC SHOP 18	VEH947	PSBV	Todd Winkler	RP	206-221-4903	206-734-5932	2	Inventory Owner
UWF-MC SHOP 32	140	Not Set	Alison Robinson	RP	206-685-4665		62	Inventory Owner
UWF-MC SHOP 41	222	PSB2	ERIC YERXA	RP	206-221-2672	206-396-1271	7	Inventory Owner
UWF-MC SHOP 41	231 NORTH SHELVES	PSB2	ERIC YERXA	RP	206-221-2672	206-396-1271	18	Inventory Owner
UWF-MC SHOP 41	236	PSB2	ERIC YERXA	RP	206-221-2672	206-396-1271	1	Inventory Owner
UWF-MC SHOP 41	238	PSB2	ERIC YERXA	RP	206-221-2672	206-396-1271	3	Inventory Owner
UWF-MC SHOP 41	VEH14001	PSBV	ERIC YERXA	RP	206-221-2672	206-396-1271	0	Inventory Owner
UWF-MC SHOP 41	VEH14014	PSBV	ERIC YERXA	RP	206-221-2672	206-396-1271	3	Inventory Owner
UWF-MC SHOP 53	216A	PSB2	THEODORE SCHMITZ	RP	206-661-2548		83	Inventory Owner
UWF-MC SHOP 53	229	PSB2	THEODORE SCHMITZ	RP	206-661-2548		12	Inventory Owner
UWF-MC SHOP 53	229D	PSB2	THEODORE SCHMITZ	RP	206-661-2548		15	Inventory Owner
UWF-MC SHOP 53	235	PSB2	THEODORE SCHMITZ	RP	206-661-2548		1	Inventory Owner
UWF-MC SHOP 53	237A	PSB2	THEODORE SCHMITZ	RP	206-661-2548		34	Inventory Owner

Plant Services Building

UWF-MC SHOP 53	VAN083	PSBV	THEODORE SCHMITZ	RP	206-661-2548		13	Inventory Owner
UWF-MC SHOP 53	VAN388	PSBV	THEODORE SCHMITZ	RP	206-661-2548		0	Inventory Owner
UWF-MC SHOP 53	VAN390	PSBV	THEODORE SCHMITZ	RP	206-661-2548		15	Inventory Owner
UWF-MC SHOP 53	VAN416	PSBV	THEODORE SCHMITZ	RP	206-661-2548		15	Inventory Owner
UWF-MC SHOP 53	VAN431	PSBV	THEODORE SCHMITZ	RP	206-661-2548		4	Inventory Owner
UWF-MC SHOP 53	VAN449	PSBV	THEODORE SCHMITZ	RP	206-661-2548		9	Inventory Owner
UWF-MC SHOP 53	VAN470	PSBV	THEODORE SCHMITZ	RP	206-661-2548		4	Inventory Owner
UWF-MC SHOP 53	VAN631	PSBV	THEODORE SCHMITZ	RP	206-661-2548		0	Inventory Owner
UWF-MC SHOP 54	203	PSB2	Andrew Schlais	RP	206-661-9572	206-685-1489	188	Inventory Owner
UWF-MC SHOP 54	203F	PSB2	Andrew Schlais	RP	206-661-9572	206-685-1489	0	Inventory Owner
UWF-MC SHOP 54	208	PSB208H	ROD S. HALL	Area	206-510-1990		115	Inventory Access
UWF-MC SHOP 54	208	PSB208H	JOHN F. ECKHOUSE	RP	206-685-1578		115	Inventory Owner
UWF-MC SHOP 54	216	PSB2	ROD S. HALL	Area	206-510-1990		153	Inventory Access
UWF-MC SHOP 54	216	PSB2	JOHN F. ECKHOUSE	RP	206-685-1578		153	Inventory Owner
UWF-MC SHOP 54	216B	PSB2	ROD S. HALL	Area	206-510-1990		186	Inventory Access

Plant Services Building

UWF-MC SHOP 54	216B	PSB2	JOHN F. ECKHOUSE	RP	206-685-1578		186	Inventory Owner
UWF-MC SHOP 54	216C	PSB2	ROD S. HALL	Area	206-510-1990		15	Inventory Access
UWF-MC SHOP 54	216C	PSB2	JOHN F. ECKHOUSE	RP	206-685-1578		15	Inventory Owner
UWF-MC SHOP 54	216D	PSB2	ROD S. HALL	Area	206-510-1990		0	Inventory Access
UWF-MC SHOP 54	216D	PSB2	JOHN F. ECKHOUSE	RP	206-685-1578		0	Inventory Owner
UWF-MC SHOP 54	218A	PSB2	JOHN F. ECKHOUSE	RP	206-685-1578		31	Inventory Owner
UWF-MC SHOP 54	218B	PSB2	JOHN F. ECKHOUSE	RP	206-685-1578		12	Inventory Owner
UWF-MC SHOP 54	225	PSB2	JOHN F. ECKHOUSE	RP	206-685-1578		73	Inventory Owner
UWF-MC SHOP 54	226	PSB2	Robert Melapioni	Area	2063849610		46	Inventory Access
UWF-MC SHOP 54	226	PSB2	JOHN F. ECKHOUSE	RP	206-685-1578		46	Inventory Owner
UWF-MC SHOP 54	CONNEX	PSBX	JOHN F. ECKHOUSE	RP	206-685-1578		0	Inventory Owner
UWF-MC SHOP 54	TRUCK278	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		0	Inventory Owner
UWF-MC SHOP 54	VAN239	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		3	Inventory Owner
UWF-MC SHOP 54	VAN24001	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		16	Inventory Owner
UWF-MC SHOP 54	VAN286	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		0	Inventory Owner

Plant Services Building

UWF-MC SHOP 54	VAN309	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		13	Inventory Owner
UWF-MC SHOP 54	VAN381	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		8	Inventory Owner
UWF-MC SHOP 54	VAN415	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		24	Inventory Owner
UWF-MC SHOP 54	VAN424	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		21	Inventory Owner
UWF-MC SHOP 54	VAN425	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		25	Inventory Owner
UWF-MC SHOP 54	VAN471	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		1	Inventory Owner
UWF-MC SHOP 54	VAN473	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		11	Inventory Owner
UWF-MC SHOP 54	VAN672	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		0	Inventory Owner
UWF-MC SHOP 54	VAN859	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		11	Inventory Owner
UWF-MC SHOP 54	VAN873	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		6	Inventory Owner
UWF-MC SHOP 54	VEH24000	PSBV	JOHN F. ECKHOUSE	RP	206-685-1578		11	Inventory Owner
UWF-MC SHOP 54	VEH24026	Not Set	JOHN F. ECKHOUSE	RP	206-685-1578		6	Inventory Owner
UWF-MC SHOP 54	VEH24028	Not Set	JOHN F. ECKHOUSE	RP	206-685-1578		6	Inventory Owner
UWF-MC SHOP 56	231	PSB2	Andy Clark	RP	206-221-2565		73	Inventory Owner
UWF-MC SHOP 56	231CAGE	PSB2	Andy Clark	RP	206-221-2565		12	Inventory Owner

Plant Services Building

UWF-MC SHOP 56	231D	PSB2	Andy Clark	RP	206-221-2565		5	Inventory Owner
UWF-MC SHOP 56	231E	PSB2	Andy Clark	RP	206-221-2565		0	Inventory Owner
UWF-MC SHOP 56	233	PSB2	Andy Clark	RP	206-221-2565		75	Inventory Owner
UWF-MC SHOP 56	LDOCK WEST FC	PSBX	Andy Clark	RP	206-221-2565		41	Inventory Owner
UWF-MC SHOP 56	VAN269	PSBV	Andy Clark	RP	206-221-2565		1	Inventory Owner
UWF-MC SHOP 56	VAN307	PSBV	Andy Clark	RP	206-221-2565		11	Inventory Owner
UWF-MC SHOP 56	VAN421	PSBV	Andy Clark	RP	206-221-2565		5	Inventory Owner
UWF-MC SHOP 56	VAN438	PSBV	Andy Clark	RP	206-221-2565		23	Inventory Owner
UWF-MC SHOP 56	VAN445	PSBV	Andy Clark	RP	206-221-2565		16	Inventory Owner
UWF-MC SHOP 56	VAN483	PSBV	Andy Clark	RP	206-221-2565		2	Inventory Owner
UWF-MC SHOP 56	VEH 24032	PSBV	Andy Clark	RP	206-221-2565		2	Inventory Owner
UWF-MC SHOP 82	121	PSB1	Sergio Escobedo	RP	206-388-8202		253	Org Manager
UWF-MC SHOP 82	122	PSB1	Jeanel Cassidy {she, her}	RP	206-616-3705		28	Inventory Owner
UWF-MC SHOP 82	122	PSB1	MICHAEL K MORRIS	Area	206-685-2797		28	Inventory Owner
UWF-MC SHOP 82	144	PSB144H	Sergio Escobedo	RP	206-388-8202		23	Org Manager
UWF-MC SHOP 82	216E	PSB2	Sergio Escobedo	RP	206-388-8202		54	Org Manager
UWF-TS SHOP 86	150	PSB1	Eric Johnson	Area	206 499-7167		10	Inventory Access

Plant Services Building

UWF-TS SHOP 86	150	PSB1	GHEBREALIF HAILEMARIAM	Area	206-391-9901		10	Inventory Access
UWF-TS SHOP 86	150	PSB1	Rick Libsack	RP	206-698-4498	206-698-4498	10	Inventory Owner
UWF-TS SHOP 86	156A	PSB1	Cynthia Conroy	Area	206-543-2940		23	Inventory Access
UWF-TS SHOP 86	156A	PSB1	Bonnie L. Meneese	RP	206-543-9491		23	Inventory Owner
UWF-TS SHOP 86	156C	Not Set	Eric Johnson	Area	206 499-7167		5	Inventory Access
UWF-TS SHOP 86	156C	Not Set	GHEBREALIF HAILEMARIAM	Area	206-391-9901		5	Inventory Access
UWF-TS SHOP 86	156C	Not Set	Rick Libsack	RP	206-698-4498	206-698-4498	5	Inventory Owner
UWF-TS SHOP 86	157	PSB1	Eric Johnson	Area	206 499-7167		33	Inventory Access
UWF-TS SHOP 86	157	PSB1	GHEBREALIF HAILEMARIAM	Area	206-391-9901		33	Inventory Access
UWF-TS SHOP 86	157	PSB1	Rick Libsack	RP	206-698-4498	206-698-4498	33	Inventory Owner
UWF-TS SHOP 86	NORTH CAGE	PSBX	Eric Johnson	Area	206 499-7167		36	Inventory Access
UWF-TS SHOP 86	NORTH CAGE	PSBX	GHEBREALIF HAILEMARIAM	Area	206-391-9901		36	Inventory Access
UWF-TS SHOP 86	NORTH CAGE	PSBX	Rick Libsack	RP	206-698-4498	206-698-4498	36	Inventory Owner
UWF-TS SHOP 86	OUTSD GRAY CABNT	PSBX	Cynthia Conroy	Area	206-543-2940		14	Inventory Access
UWF-TS SHOP 86	OUTSD GRAY CABNT	PSBX	Bonnie L. Meneese	RP	206-543-9491		14	Inventory Owner

APPENDIX B: CRITICAL EQUIPMENT SHUTDOWN

There is no critical equipment in the Plant Services Building which requires shutdown in the event of an emergency evacuation. Should a shutdown be required as determined by emergency personnel after an evacuation, contact the evacuation warden noted on page 37 of this plan.

Plant Services Building

APPENDIX C: LIST OF FIRST AID KIT LOCATIONS

If all shop vehicles contain first aid kits, write 'all vehicles' as a location in your shop first aid kit listed. Other aid equipment to list the locations for include AEDs and Severe Bleed kits (to be used only by specifically trained employees).

Location	First Aid Kit	AED	Severe Bleed Kit
All vehicles	Yes	No	No
Floor 01 – Stores Breakroom	Yes	Yes	No
Floor 01 – Stores Receiving	Yes	Yes	No
Floor 01 – Stores Office	Yes – Portable	No	No
Floor 01 – Stores Counter	Yes – Portable	No	No
Floor 01 – Surplus Receiving	Yes - Portable	No	No
Floor 01 – Surplus South end	Yes	No	No
Floor 01 – Training Center Breakroom	Yes	Yes	No
Floor 01 - Transportation	Yes	No	No
Floor 02 – Outside Main Admin Office	Yes	Yes	No
Floor 02 – South End Carpenter Shop	Yes	No	Yes
Floor 02 – Shop 54 Area	Yes	No	No
Floor 02 – Shop 56 Area	Yes	No	No
Floor 02 – Near Room 222	Yes	No	Yes
Floor 02 – Shop 10 Area	Yes	Yes	Yes
Floor 02 – Shop 15 Area	Yes	No	Yes

APPENDIX D: ADDITIONAL CONSIDERATIONS

This section includes any additional documentation such as evacuation exemptions and any other information that could be considered critical information during a building emergency.

Examples of items you may want to include in this section:

- Evacuation exemptions. For more information see https://www.ehs.washington.edu/system/files/resources/Evacuation_Exemption_Focus_Sheet.pdf
- Completed evacuation plan for persons with disabilities. A form can be found at <https://www.ehs.washington.edu/resource/evacuation-plan-individuals-disabilities-595>

APPENDIX E: BOMB THREAT CHECKLIST

Report all bomb threats immediately to UWPD at 9-1-1 (TDD 206-543-3323) _____

Questions to Ask Caller

When will the bomb explode?

Where is the bomb?

What does it look like?

What kind of bomb is it?

What will cause it to explode?

Did you place the bomb?

Why?

What is your name?

Where are you calling from?

What is your address?

Exact words of caller:

Describe the caller's voice (Circle all that apply)

Male

Female

Calm

Disguised

Nasal

Angry

Broken

Stutter

Slow

Sincere

Lisp

Rapid

Giggling

Deep

Crying

Squeaky

Excited

Stressed

Accent

Loud

Slurred

Normal

Additional Information

WORK SAFE, HOME SAFE

Plant Services Building

Was the caller male or female?

If the voice is familiar, whom did it sound like?

Were there any background noises?

Information summary of a telephoned threat

Exact time of call:

Date received and phone
number displayed (caller ID):

Phone number received at:

Person who received the call: *(Insert full name and contact information)*

APPENDIX F: POST-EARTHQUAKE CHECKLIST

The purpose of this form is to provide evacuation directors, building coordinators, or other responsible persons a tool to determine if a University building may (or may not) remain occupied following an earthquake when structural assessment experts (ATC-20) are not available. This checklist also serves as a reporting tool to help direct damage assessment teams. Responsible persons should keep hardcopies available or bookmark the link to this form.

The decision to evacuate should be based on the level of damage to the structure. Minor and moderate earthquakes ([magnitude 3.0 to 5.9](#)) generally do *not* require building evacuation. After a major earthquake (magnitude 6.0 to 7.9), it may be necessary for UW personnel and students to shelter in place in University buildings until it is safe to travel.

INSTRUCTIONS

- 1. Complete Checklist 1 after an earthquake at or above magnitude 3.0.**
 - a. If you mark “yes” to any condition, evacuate the building. Record any safety issue(s) you notice as you exit the building.
 - b. If you do *not* mark “yes” to any condition on Checklist 1, it is *not* necessary to evacuate the building. Go to step 2.
- 2. If no conditions warrant immediate building evacuation, **complete Checklist 2 to identify reportable safety conditions.****
 - a. Isolate areas that present a hazard; post warning signs to warn occupants.
 - b. The evacuation director, building coordinator or other responsible person should complete two copies of this checklist. Deliver one copy to your campus Emergency Operations Center (via runner if necessary) and provide the second copy to the ATC-20 representative when they arrive.

Seattle campus Emergency Operations Center (UW Tower Suite C-140)

Phone/Fax/Email: 206-897-8000/206-897-8001/disaster@uw.edu

UW Bothell Emergency Management Contact

Phone/Email: 425-352-5359/uwb-safety@uw.edu

UW Tacoma Emergency Management Contact

Phone/Email: 253-692-4416/uwtsafe@uw.edu

Plant Services Building

3. It may be necessary to conduct another evaluation following aftershocks.

Evacuated buildings must remain evacuated until the ATC-20 structural assessment team or local fire department has determined the building is safe for re-entry.

Respond to emerging [building emergencies](#) using procedures found on the EH&S website.

SHELTERING IN PLACE

Some buildings are good candidates for sheltering in place, but others are not. For example, a building without power and ventilation may not be a good candidate for sheltering in place.

Building name: _____

Date: _____

Completed by: _____

Time: _____

Email address: _____

Phone: _____

Plant Services Building

CHECKLIST 1: IMMEDIATE EVACUATION

Evacuate the entire building immediately if you check "yes" to any of the following conditions. Report life safety emergencies by calling 9-1-1.

Condition	Yes	No	N/A
Walls, support columns or beams are cracked, bent, twisted, sagging or leaning.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Uneven floors, major cracks or obvious structural damage.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Severely damaged ceilings, falling light fixtures, HVAC diffusers or other ceiling equipment.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Damaged electrical panels, circuits or exposed electrical wire or components.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Flooding from broken or damaged pipe and plumbing systems that affect multiple spaces, not contained and anticipated to get worse.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Strong and persistent natural gas odor or hissing noise from what might be a gas leak.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Uncontained chemicals or other hazardous materials spill that could present a health exposure, chemical reaction, fire, explosion or other adverse outcome.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Damaged or leaking compressed gas cylinders, pressure vessels or hazardous materials storage tanks.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Equipment and furnishings toppled over blocking one or more required exits.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Severely damaged fireproofing that is known to contain asbestos, affecting habitable space.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Damage to stairs, stairwells, or exit ways, including doors that will not easily open.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Containment failure of hazardous spaces and processes that could present a health exposure to occupants immediately or after a period of time. Note: Ventilation failure in laboratory space with significant chemical inventory and active processes when there is no emergency power, for example, may require evacuation.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Notes:

Plant Services Building

CHECKLIST 2: REPORTABLE CONDITIONS

These conditions may not require building evacuation; however, they should be reported. Post “DANGER – DO NOT ENTER” signs at access points to area(s) with unsafe conditions and advise building occupants to avoid the area(s).

Condition	Yes	No	N/A
Elevator stuck between floors or doors stuck closed or partly open	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Displaced or fallen ceiling tiles (avoid occupancy of these spaces)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Equipment, furnishings, supplies spilled or toppled over (but exits are accessible)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Broken/damaged windows, skylights or other building glass	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Minor and other cosmetic cracks in walls, floors and partitions	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Lack of water, power, steam, data and other utilities	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Minor water leaks and localized but contained flooding	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Doors or windows difficult to open or close	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Obvious exterior damage with bricks, mortars, stonework, chimneys	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Contained hazardous material spill/release that does not present health or fire hazard	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Notes:

Useful Resources:

- [Earthquake Planning for Chemical Storage Areas Focus Sheet](#) includes special considerations for these spaces.